


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:88.300V I:0.5260A P:46.440W PF:1.0000 Freq:0Hz Lamp Flux:8315.22x1 lm		
NAME: B065 -日亜-R	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:0.04*0.9	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 179.05 lm/W			
MODEL	B065 -日亜-R	I _{max} (cd)	7639	S/MH(C0/180)	0.97
NOMINAL POWER(W)	46.44	LOR(%)	100.0	S/MH(C90/270)	0.65
RATED VOLTAGE(V)	88.3	TOTAL FLUX(lm)	8315.2	η UP,DN(C0-180)	0.7,57.4
NOMINAL FLUX(lm)	8315.22	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.8,41.1
LAMPS INSIDE	1	η up(%)	1.5	CIBSE SHR NOM	0.75
TEST VOLTAGE(V)	88.3	η down(%)	98.5	CIBSE SHR MAX	0.95

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

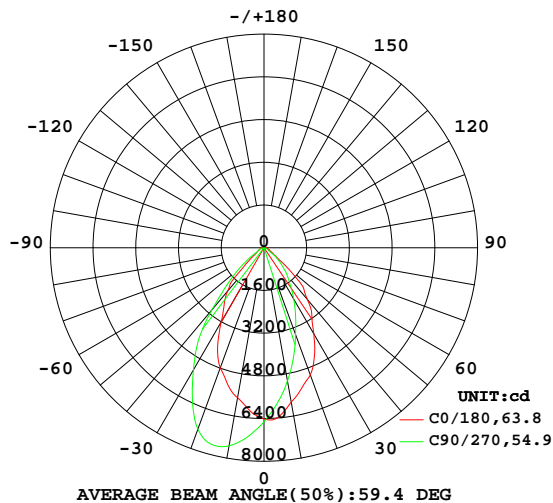

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

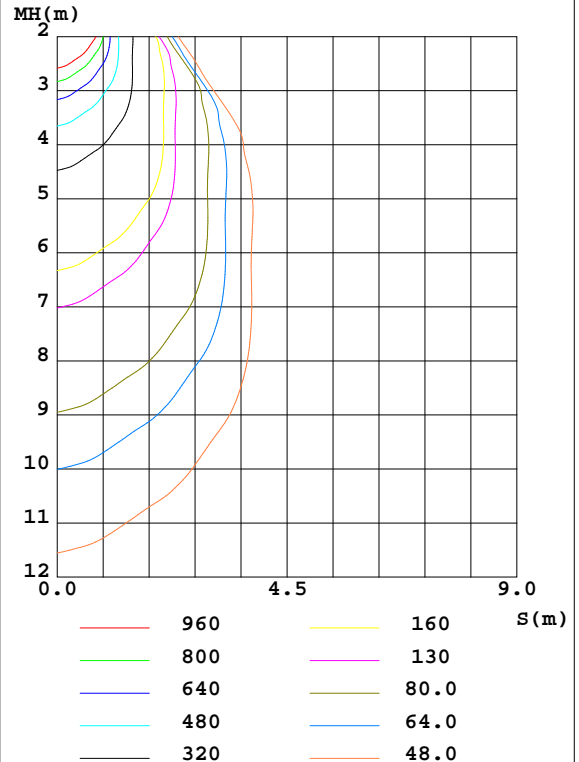

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:1
 Test Date:2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.421
 Humidity:65.0%
 Test Distance:9.886m [K=1.0000]
 Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	5706	6710	7533	6924	5877	5233	5073	5089	0- 10	597.1	597.1	7.18,7.18
20	4791	5984	7238	6369	5072	3822	3457	3795	10- 20	1569	2166	26,26
30	3209	4222	5294	4804	3742	2897	2241	2842	20- 30	2004	4170	50.2,50.2
40	2131	2262	3045	2699	2533	1905	1356	1794	30- 40	1808	5978	71.9,71.9
50	700.3	1113	1211	1351	1076	1112	670.8	978.9	40- 50	1256	7234	87,87
60	274.7	353.2	286.4	349.9	332.4	368.5	187.2	312.6	50- 60	513.4	7747	93.2,93.2
70	176.5	194.8	160.8	205.3	204.5	175.7	109.9	159.3	60- 70	231.6	7979	96,96
80	115.9	87.23	40.70	96.86	125.1	86.01	30.75	72.51	70- 80	140.0	8119	97.6,97.6
90	98.32	39.88	1.089	39.91	97.71	29.30	1.566	23.65	80- 90	67.77	8187	98.5,98.5
100	25.07	7.919	1.392	17.19	41.07	13.25	2.424	6.791	90-100	36.87	8224	98.9,98.9
110	11.36	8.053	2.651	6.754	9.105	7.662	5.875	9.856	100-110	9.880	8233	99,99
120	12.78	7.697	5.352	6.643	12.44	10.35	12.21	12.23	110-120	8.847	8242	99.1,99.1
130	16.74	11.23	9.601	10.46	14.02	17.30	21.09	18.96	120-130	11.02	8253	99.3,99.3
140	20.80	17.15	15.26	16.18	20.73	26.58	30.60	28.21	130-140	14.16	8267	99.4,99.4
150	29.00	24.92	22.54	23.43	29.23	35.90	39.15	36.85	140-150	16.18	8284	99.6,99.6
160	38.20	33.63	30.94	32.06	38.02	43.35	45.36	43.43	150-160	15.68	8299	99.8,99.8
170	45.55	41.63	39.53	40.49	45.32	47.56	48.31	47.15	160-170	11.60	8311	99.9,99.9
180	48.75	47.71	46.77	47.07	48.55	47.68	46.74	47.12	170-180	4.345	8315	100,100
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 6691.5 lm

%lum = 80.5%

%lamp = 80.5%

Conical surface Flux(120deg): 7747.3 lm


%lum = 93.2%

%lamp = 93.2%

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:1
 Test Date:2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 γ Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.421
 Humidity:65.0%
 Test Distance:9.886m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

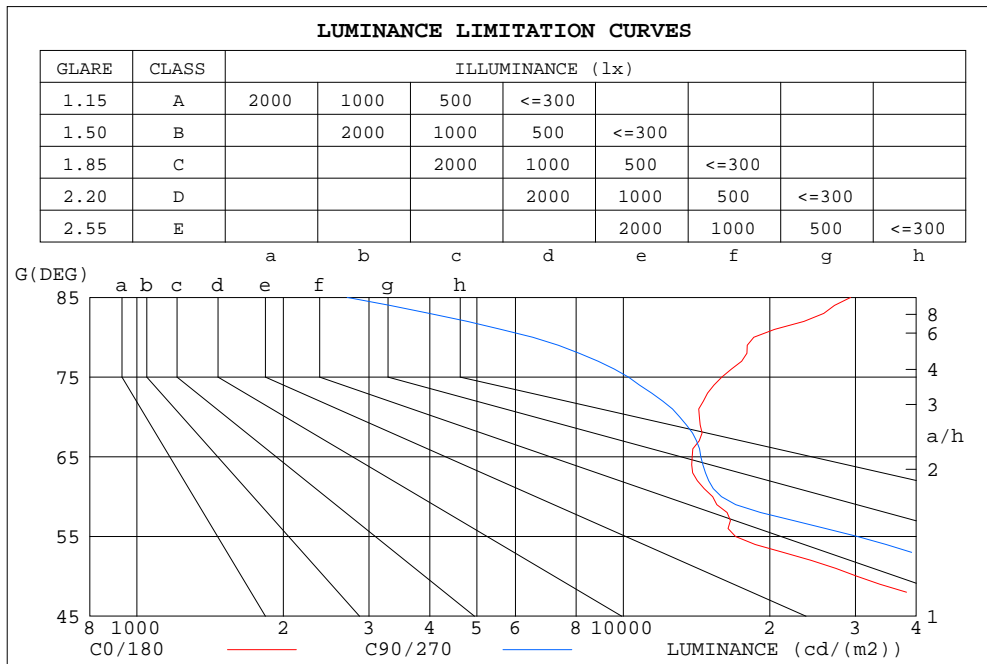


LUMINANCE cd/(m2)		
G(DEG)	C0/180	C90/270
85	29327	2707
80	18538	6511
75	15934	10247
70	14337	13058
65	13852	14435
60	15263	15913
55	17006	30302
50	30263	52328
45	56690	76645

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: 1
 Test Date: 2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.421
 Humidity: 65.0%
 Test Distance: 9.886m [K=1.0000]
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.10	1.10	1.10	1.05	1.05	1.05	1.01	1.01	1.01	.98
1.0	1.08	1.05	1.02	1.06	1.03	1.00	1.01	.99	.97	.97	.95	.94	.93	.92	.91	.89
2.0	.98	.93	.89	.96	.92	.88	.93	.89	.86	.89	.86	.84	.86	.84	.82	.80
3.0	.90	.84	.79	.88	.82	.78	.85	.80	.76	.82	.78	.75	.80	.77	.74	.72
4.0	.82	.75	.70	.81	.75	.70	.78	.73	.69	.76	.71	.68	.74	.70	.67	.65
5.0	.76	.69	.63	.74	.68	.63	.72	.67	.62	.70	.65	.62	.69	.64	.61	.59
6.0	.70	.63	.58	.69	.62	.57	.67	.61	.57	.65	.60	.56	.64	.59	.56	.54
7.0	.65	.58	.53	.64	.57	.52	.62	.56	.52	.61	.56	.51	.60	.55	.51	.49
8.0	.60	.53	.48	.59	.53	.48	.58	.52	.48	.57	.51	.47	.56	.51	.47	.46
9.0	.56	.49	.45	.55	.49	.44	.54	.48	.44	.53	.48	.44	.52	.47	.44	.42
10.0	.52	.46	.41	.52	.46	.41	.51	.45	.41	.50	.45	.41	.49	.44	.41	.39

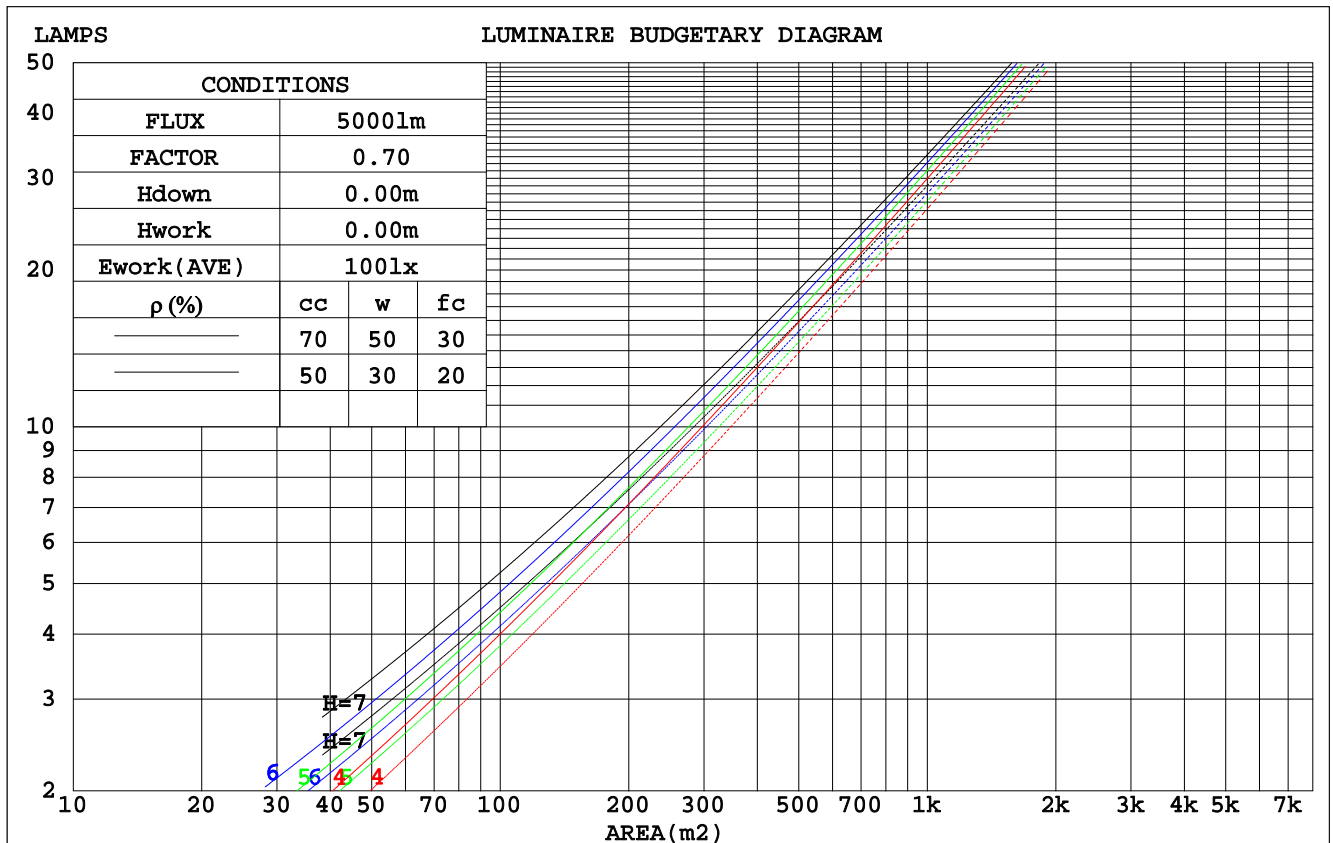

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: 1
 Test Date: 2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.421
 Humidity: 65.0%
 Test Distance: 9.886m [K=1.0000]
 Remarks:

WEC AND CCEC

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.223	.127	.040	.216	.123	.039	.202	.116	.037	.190	.109	.035	.178	.103	.033		
2.0	.213	.117	.036	.207	.114	.035	.195	.108	.034	.184	.103	.032	.174	.098	.031		
3.0	.201	.107	.032	.196	.105	.032	.185	.100	.031	.176	.096	.030	.167	.093	.029		
4.0	.190	.099	.029	.185	.097	.029	.176	.093	.028	.168	.090	.027	.160	.087	.026		
5.0	.179	.091	.026	.175	.090	.026	.167	.087	.026	.160	.084	.025	.153	.082	.025		
6.0	.170	.085	.024	.166	.084	.024	.159	.081	.024	.152	.079	.023	.146	.077	.023		
7.0	.161	.079	.023	.157	.078	.022	.151	.076	.022	.145	.074	.022	.139	.072	.021		
8.0	.152	.074	.021	.149	.074	.021	.144	.072	.020	.138	.070	.020	.133	.068	.020		
9.0	.145	.070	.020	.142	.069	.019	.137	.068	.019	.132	.066	.019	.127	.065	.019		
10.0	.138	.066	.018	.135	.065	.018	.131	.064	.018	.126	.063	.018	.122	.061	.018		

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.202	.202	.202	.173	.173	.173	.118	.118	.118	.068	.068	.068	.022	.022	.022	
1.0	.186	.169	.153	.159	.145	.132	.109	.100	.091	.063	.058	.053	.020	.019	.017	
2.0	.174	.144	.120	.149	.124	.103	.102	.086	.072	.059	.050	.042	.019	.016	.014	
3.0	.163	.126	.096	.140	.109	.083	.096	.075	.058	.055	.044	.034	.018	.014	.011	
4.0	.154	.112	.079	.132	.097	.069	.091	.067	.048	.053	.039	.029	.017	.013	.009	
5.0	.146	.101	.067	.126	.087	.058	.087	.061	.041	.050	.036	.024	.016	.012	.008	
6.0	.139	.092	.058	.120	.080	.050	.083	.056	.036	.048	.033	.021	.015	.011	.007	
7.0	.133	.085	.051	.115	.073	.044	.079	.051	.031	.046	.030	.019	.015	.010	.006	
8.0	.127	.079	.045	.110	.068	.039	.076	.048	.028	.044	.028	.017	.014	.009	.006	
9.0	.122	.074	.041	.105	.064	.036	.073	.045	.025	.042	.027	.015	.014	.009	.005	
10.0	.117	.069	.037	.101	.060	.033	.070	.042	.023	.041	.025	.014	.013	.008	.005	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: 1
 Test Date: 2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.421
 Humidity: 65.0%
 Test Distance: 9.886m [K=1.0000]
 Remarks:

UGR(Unified Glare Rating) Table

ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	22.8	23.9	23.0	24.1	24.4	24.5	25.6	24.7	25.8	26.0
3H	23.1	24.1	23.4	24.4	24.6	24.6	25.6	24.9	25.9	26.1
4H	23.3	24.3	23.6	24.5	24.8	24.6	25.6	24.9	25.9	26.1
6H	23.6	24.5	23.9	24.8	25.1	24.6	25.5	24.9	25.8	26.1
8H	23.8	24.7	24.2	25.0	25.3	24.5	25.4	24.9	25.7	26.0
12H	24.0	24.9	24.4	25.2	25.5	24.5	25.4	24.9	25.7	26.0
4H 2H	22.8	23.8	23.1	24.1	24.3	24.4	25.4	24.7	25.6	25.9
3H	23.3	24.1	23.6	24.4	24.7	24.6	25.5	24.9	25.8	26.1
4H	23.6	24.4	24.0	24.8	25.1	24.7	25.5	25.1	25.8	26.2
6H	24.1	24.8	24.6	25.2	25.6	24.7	25.4	25.2	25.8	26.2
8H	24.5	25.1	24.9	25.5	25.9	24.7	25.4	25.2	25.8	26.2
12H	24.8	25.4	25.3	25.8	26.3	24.7	25.3	25.1	25.7	26.1
8H 4H	23.7	24.4	24.2	24.8	25.2	24.7	25.3	25.1	25.7	26.1
6H	24.4	24.9	24.9	25.3	25.8	24.8	25.4	25.3	25.8	26.2
8H	24.9	25.3	25.4	25.8	26.3	24.9	25.4	25.4	25.8	26.3
12H	25.4	25.8	25.9	26.3	26.8	24.9	25.3	25.4	25.8	26.3
12H 4H	23.7	24.3	24.2	24.7	25.1	24.7	25.3	25.1	25.7	26.1
6H	24.4	24.9	24.9	25.3	25.8	24.9	25.3	25.3	25.8	26.3
8H	24.9	25.3	25.4	25.8	26.3	24.9	25.3	25.4	25.8	26.3
Variations with the observer position at spacings:										
S = 1.0H	+ 1.1 / - 1.4					+ 1.9 / - 2.5				
1.5H	+ 1.2 / - 1.5					+ 2.5 / - 2.7				
2.0H	+ 2.7 / - 1.2					+ 3.5 / - 3.0				

CIE Pub.117, 8315 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = 7.4$)
Area: 0.036 m²

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: 1
Test Date: 2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.421
Humidity: 65.0%
Test Distance: 9.886m [K=1.0000]
Remarks:


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS(PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	74	65	60	73	65	60	72	64	60	55
0.80	83	75	69	82	74	69	80	73	69	64
1.00	90	82	77	89	81	76	87	82	76	70
1.25	95	88	83	94	87	83	91	86	82	76
1.50	99	92	87	97	91	87	95	89	86	80
2.00	103	97	93	102	96	92	98	94	91	84
2.50	106	100	96	104	99	95	100	96	93	86
3.00	108	103	99	106	102	98	102	99	96	88
4.00	110	106	103	108	105	102	104	101	99	91
5.00	112	109	106	110	107	104	105	103	101	92
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004						Suspended			SHRNOM = 1.25	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: 1
 Test Date: 2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.421
 Humidity: 65.0%
 Test Distance: 9.886m [K=1.0000]
 Remarks:


ISOCANDELA DIAGRAM

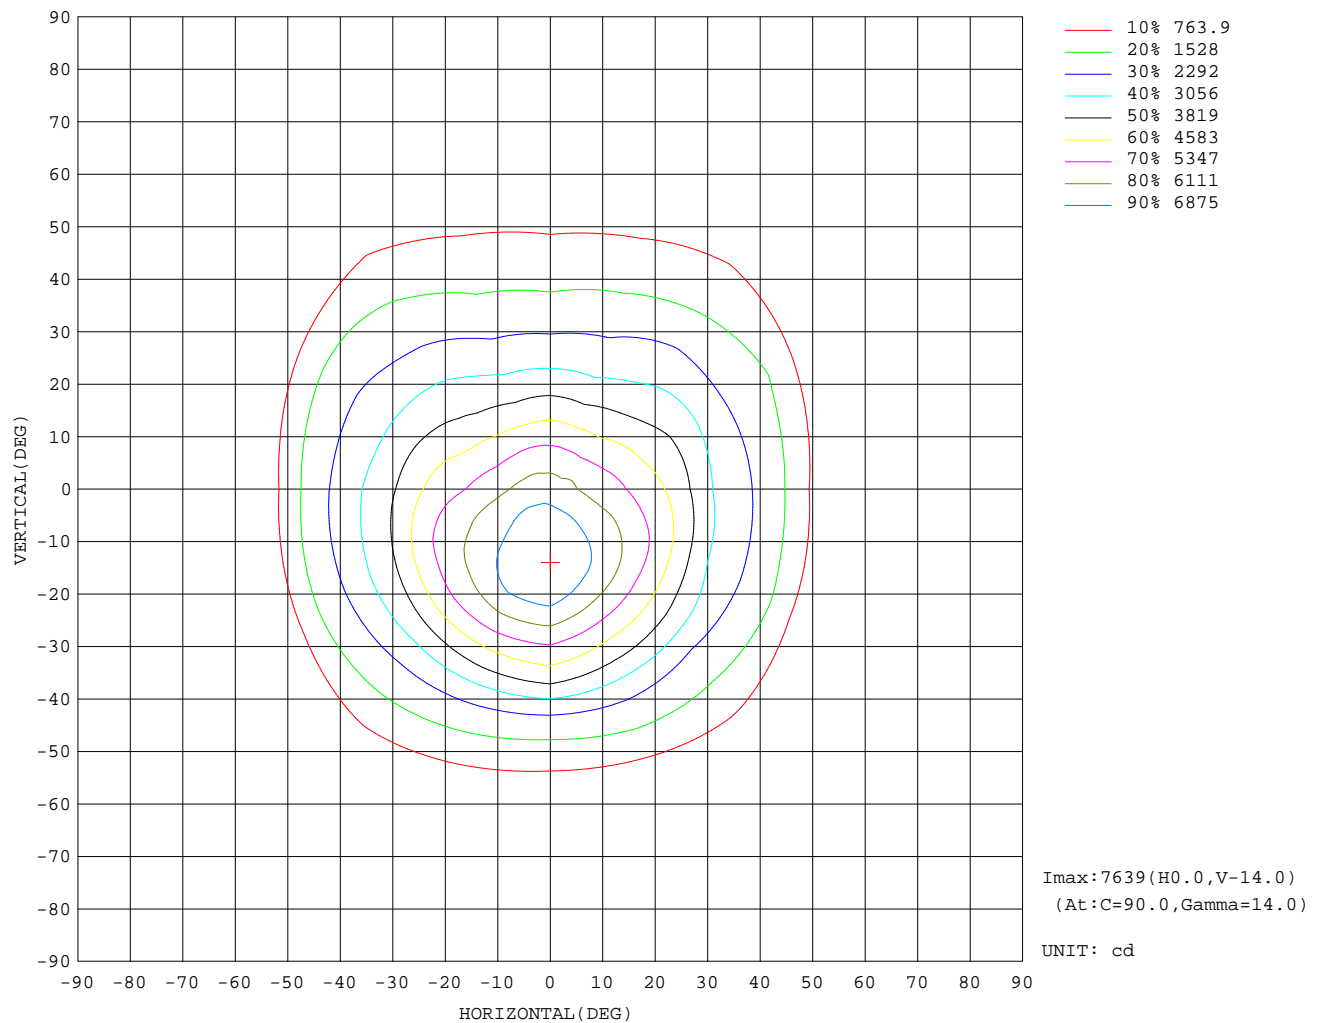

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: 1
Test Date: 2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.421
Humidity: 65.0%
Test Distance: 9.886m [K=1.0000]
Remarks:


AAI Figure

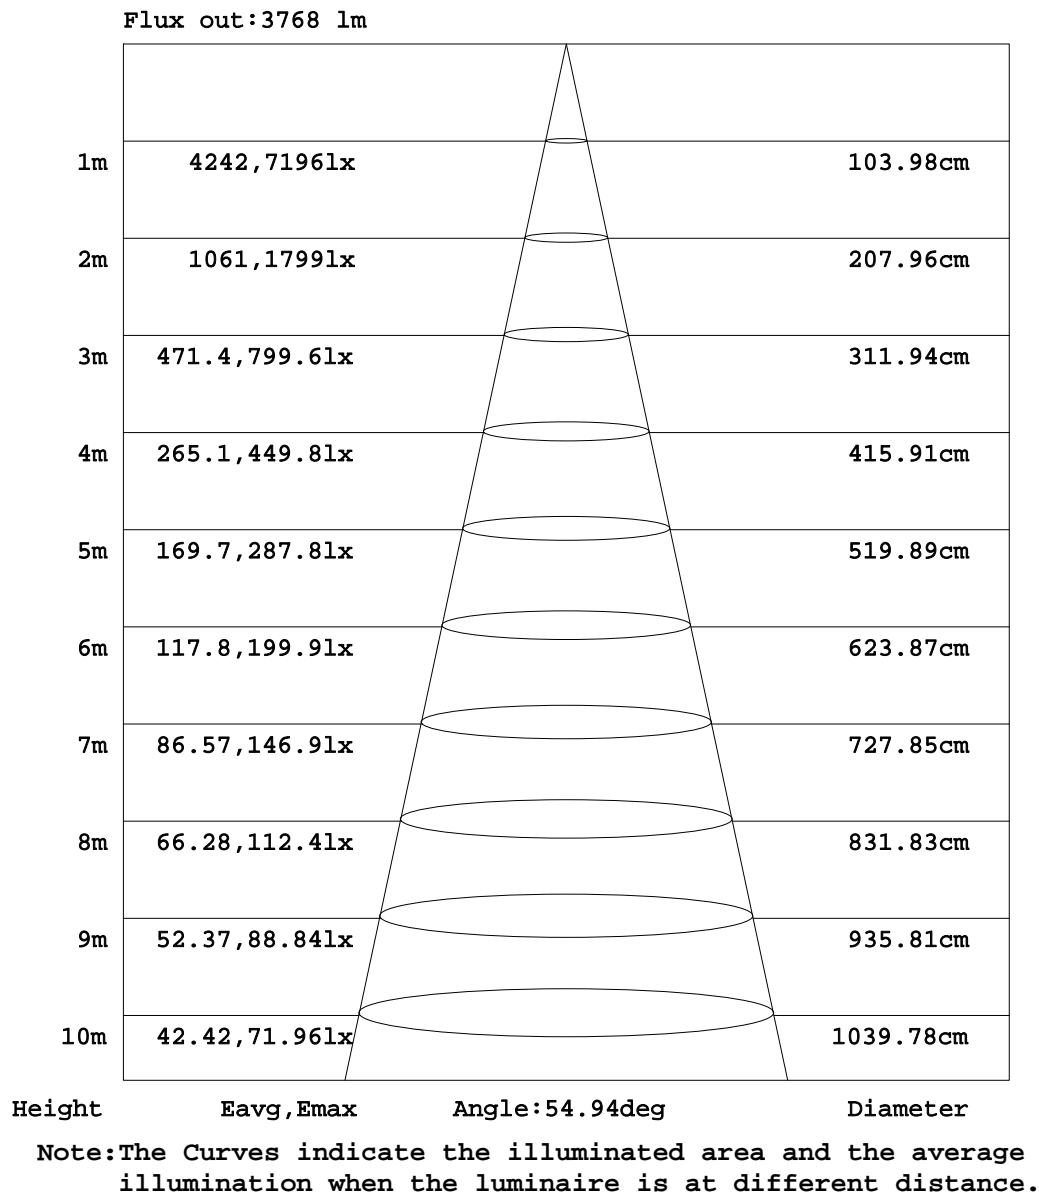

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: 1
 Test Date: 2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.421
 Humidity: 65.0%
 Test Distance: 9.886m [K=1.0000]
 Remarks:

ISOLUX DIAGRAM

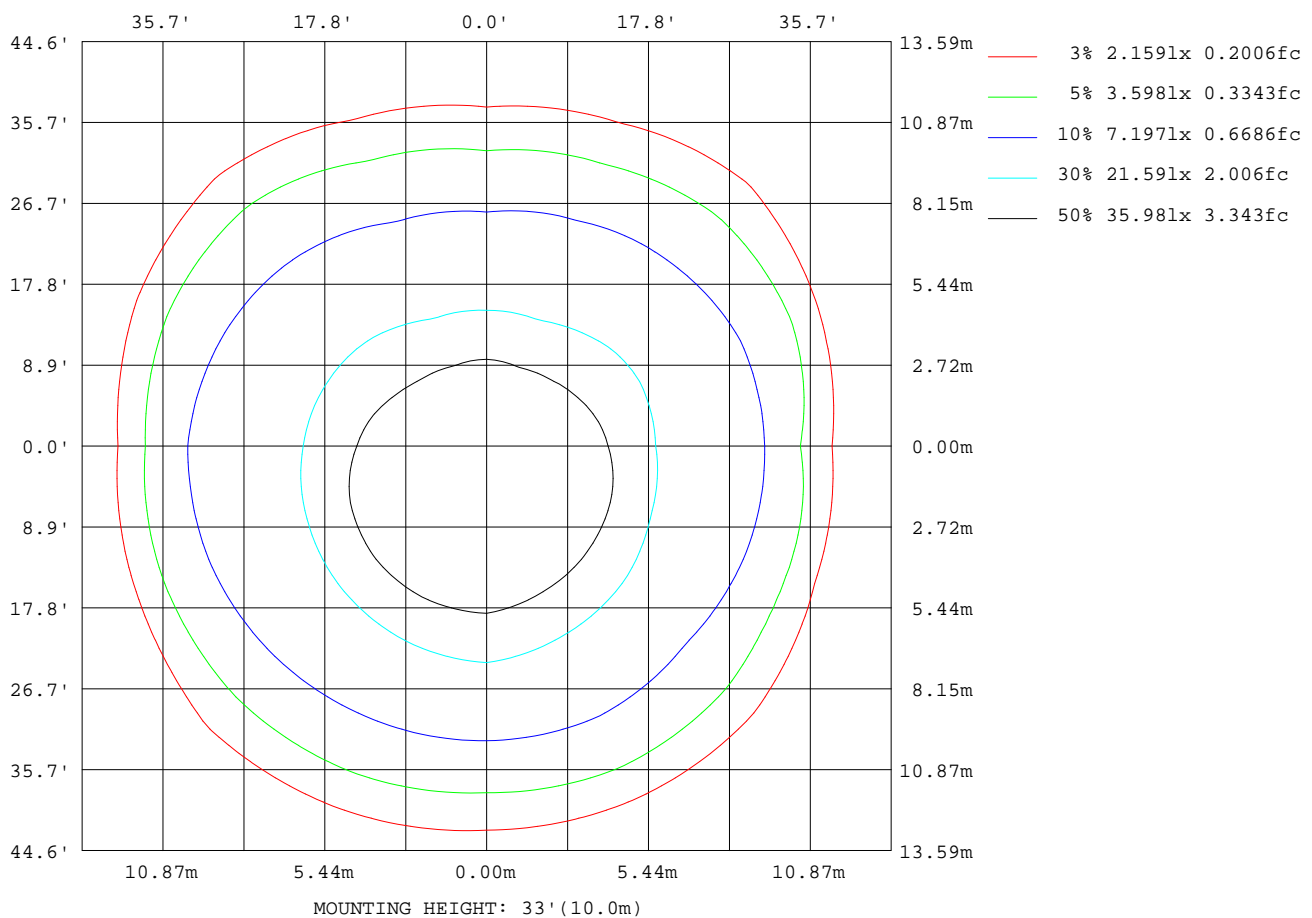

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: 1
 Test Date: 2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.421
 Humidity: 65.0%
 Test Distance: 9.886m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:88.300V I:0.5260A P:46.440W PF:1.0000 Freq:0Hz Lamp Flux:8315.22x1 lm		
NAME: B065 -日亜-R	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:0.04*0.9	Shielding Angle:


AvgL	cd/m2
L_0~180(65)av	15059
L_0~180(75)av	16431
L_0~180(85)av	33046
L_90~270(65)av	12057
L_90~270(75)av	8933
L_90~270(85)av	2723
L_45(65)av	16821
L_45(75)av	14296
L_45(85)av	16700

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:1
 Test Date:2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-2000B_V1 SYSTEM V2.00.421
 Humidity:65.0%
 Test Distance:9.886m [K=1.0000]
 Remarks:

Planar Illuminance Curve

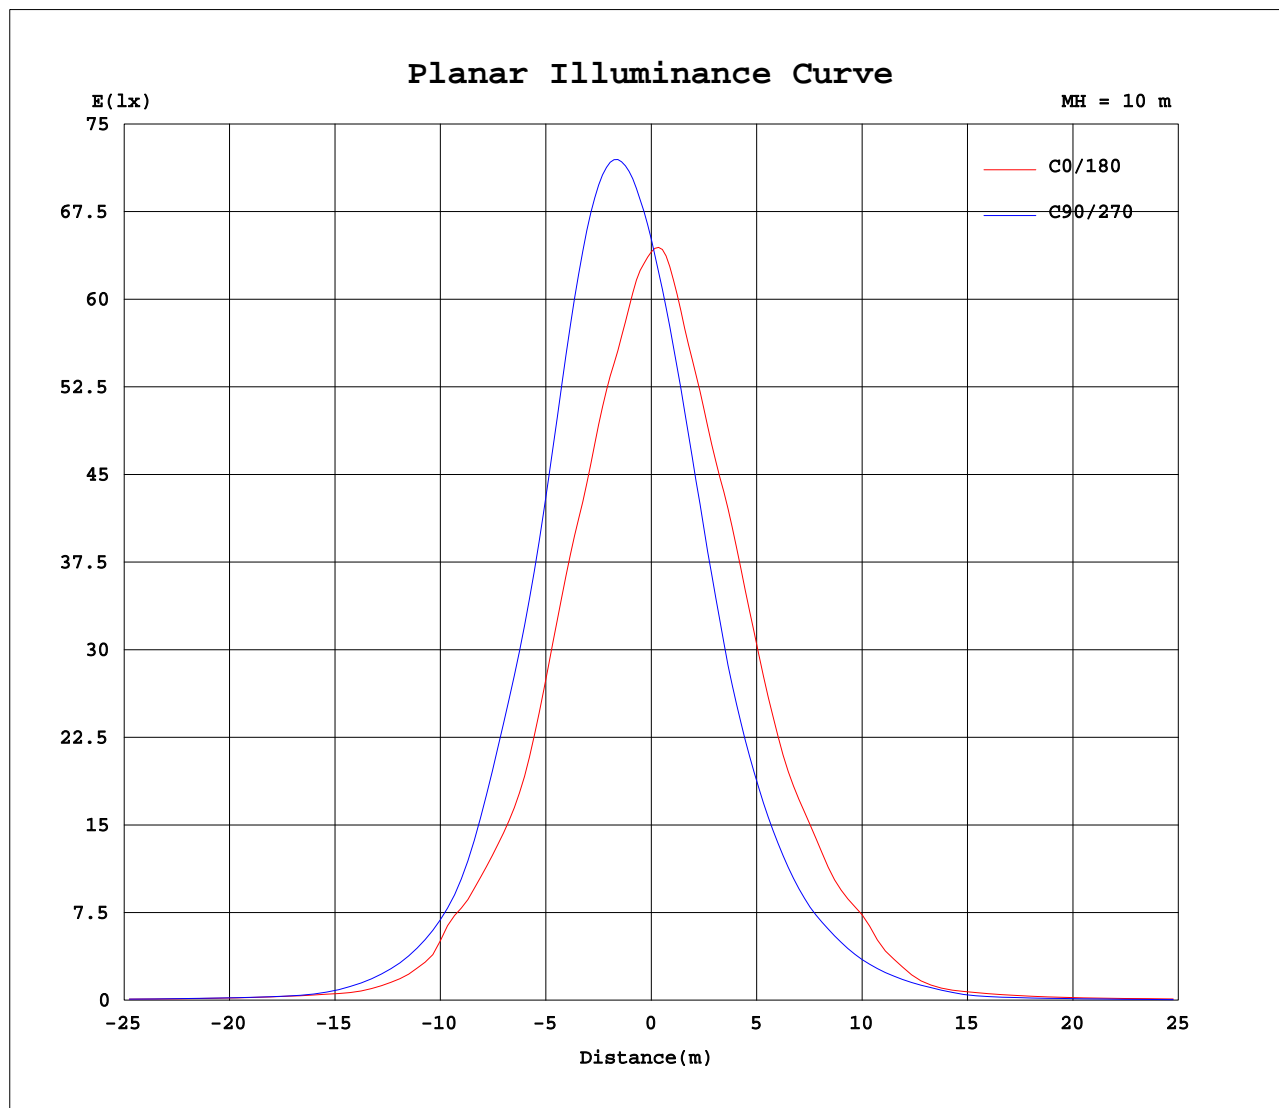

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: 1
Test Date: 2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.421
Humidity: 65.0%
Test Distance: 9.886m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Table--1

UNIT: cd

C(DEG) γ (DEG)	0	22.5	45	67.5	90	112.5	135	157.5	180	202.5	225	247.5	270	292.5	315	337.5			
0	6406	6435	6470	6480	6515	6512	6459	6525	6406	6435	6470	6480	6515	6512	6459	6525			
5	6123	6432	6733	6948	7113	7110	6902	6720	6354	6136	6002	5884	5836	5807	5842	6040			
10	5706	6198	6710	7238	7533	7492	6924	6462	5877	5470	5233	5122	5073	5047	5089	5405			
15	5287	5936	6511	7139	7623	7492	6729	6190	5452	4887	4481	4266	4260	4202	4418	4897			
20	4791	5386	5984	6572	7238	7055	6369	5829	5072	4398	3822	3480	3457	3411	3795	4297			
25	4113	4656	5116	5667	6347	6190	5701	5240	4475	3872	3311	2873	2806	2826	3209	3789			
30	3209	3608	4222	4689	5294	5120	4804	4277	3742	3302	2897	2341	2241	2362	2842	3124			
35	2607	2746	3233	3727	4316	4045	3687	3340	3130	2766	2395	1858	1738	1894	2351	2459			
40	2131	2256	2262	2677	3045	2902	2699	2776	2533	2333	1905	1484	1356	1488	1794	2054			
45	1443	1697	1696	1920	1951	1993	2051	2082	2071	1822	1556	1152	987	1110	1365	1605			
50	700	820	1113	1232	1211	1318	1351	1233	1076	1149	1112	793	671	765	979	857			
55	351	405	534	589	626	702	763	477	464	544	710	460	357	422	613	483			
60	275	311	353	333	286	346	350	345	332	352	369	251	187	227	313	302			
65	211	237	266	257	220	255	276	264	247	249	257	181	147	174	225	227			
70	177	198	195	196	161	203	205	231	204	210	176	135	110	134	159	188			
75	148	166	137	129	95.5	141	151	169	158	159	131	98.9	71.0	94.2	114	145			
80	116	123	87.2	81.4	40.7	84.1	96.9	137	125	117	86.0	64.3	30.7	56.9	72.5	110			
85	92.0	90.8	55.3	41.2	8.49	45.2	60.7	111	115	94.6	49.7	35.7	8.59	30.3	43.9	76.8			
90	98.3	91.2	39.9	14.8	1.09	18.4	39.9	90.1	97.7	75.8	29.3	15.5	1.57	11.6	23.7	70.1			
95	85.1	79.2	36.0	5.33	1.10	6.17	25.1	90.4	102	70.7	18.5	6.34	1.59	4.71	18.7	60.4			
100	25.1	17.0	7.92	4.25	1.39	4.06	17.2	35.2	41.1	30.0	13.2	5.01	2.42	5.02	6.79	14.4			
105	10.2	10.1	7.78	3.38	1.82	2.94	6.59	8.67	12.2	8.35	7.39	5.02	3.81	4.73	7.96	10.4			
110	11.4	11.0	8.05	3.43	2.65	3.02	6.75	8.08	9.11	8.48	7.66	5.72	5.88	6.14	9.86	13.2			
115	11.8	11.2	7.54	4.36	3.82	4.01	7.73	8.47	11.1	9.57	10.1	8.07	8.68	8.71	10.1	14.7			
120	12.8	11.3	7.70	5.93	5.35	5.50	6.64	10.3	12.4	12.4	10.3	11.3	12.2	12.2	12.2	17.3			
125	14.0	12.0	9.29	7.87	7.28	7.38	8.28	9.76	12.4	12.7	13.5	15.3	16.4	16.3	14.9	16.9			
130	16.7	13.6	11.2	10.1	9.60	9.60	10.5	11.5	14.0	15.5	17.3	19.9	21.1	20.9	19.0	19.6			
135	19.6	15.7	13.9	12.8	12.2	12.1	13.2	14.0	17.2	19.3	21.9	24.6	25.9	25.5	23.5	21.5			
140	20.8	18.5	17.2	15.8	15.3	15.0	16.2	16.9	20.7	23.5	26.6	29.5	30.6	30.1	28.2	25.7			
145	24.7	22.2	20.8	19.4	18.7	18.3	19.5	20.3	24.7	27.9	31.3	34.2	35.1	34.4	32.7	30.1			
150	29.0	26.6	24.9	23.3	22.5	22.1	23.4	24.1	29.2	32.5	35.9	38.5	39.1	38.4	36.9	34.6			
155	33.7	31.3	29.3	27.4	26.7	26.2	27.7	28.3	33.8	37.0	39.9	42.2	42.6	41.7	40.4	38.4			
160	38.2	35.8	33.6	31.7	30.9	30.6	32.1	32.6	38.0	40.8	43.4	45.2	45.4	44.4	43.4	41.6			
165	42.2	39.9	37.8	35.9	35.3	35.0	36.4	36.5	42.0	43.9	45.8	47.3	47.3	46.5	45.7	44.1			
170	45.5	43.4	41.6	40.1	39.5	39.2	40.5	40.3	45.3	46.4	47.6	48.4	48.3	47.6	47.2	45.7			
175	47.6	46.1	45.0	43.9	43.4	43.1	44.2	43.6	47.6	48.0	48.2	48.5	48.1	47.7	47.6	46.4			
180	48.8	48.0	47.7	47.1	46.8	46.4	47.1	46.0	48.6	48.2	47.7	47.3	46.7	46.6	47.1	46.2			

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: 1
 Test Date: 2021-11-09

γ Range: 0 - 180DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000B_V1 SYSTEM V2.00.421
 Humidity: 65.0%
 Test Distance: 9.886m [K=1.0000]
 Remarks: